

CITY OF LATHROP

Department of Public Works

DESIGN & CONSTRUCTION


Standard Details




February 2022

Electric

Typical Trench Sections	E-1
Trench Backfill Rockwheel Trench	E-2
Dry Utility Box/Pedestal Configuration Between Edges Of Driveways	E-3
Electrolier	E-4
Cobra Head Light Details For Commercial And Industrial	E-5
Electrolier Base	E-6
River Islands Electrolier Details	E-7
River Islands Double Arm Electrolier Details	E-7A
Street Light Pole Spacing Guide	E-8
Underground Utilities Locations Behind Face Of Curb	E-9
Underground Utilities Locations At Existing Intersections	E-10
Service Box Details	E-11

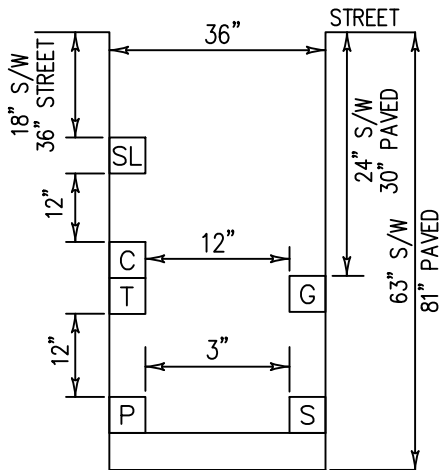


**TYPICAL JOINT TRENCH
SECTION WITH PRIMARY**

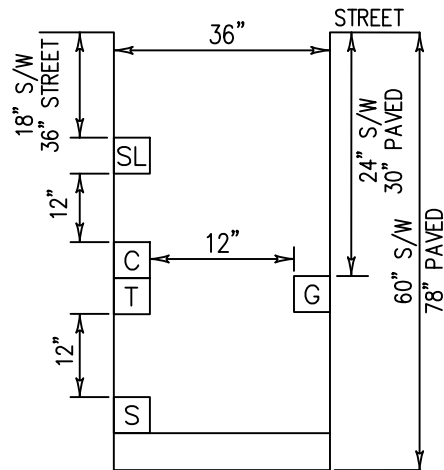

**TYPICAL JOINT TRENCH
SECTION WITHOUT PRIMARY**

NOTES FOR STREET LIGHT:

1. The street light trench shall be located underneath the sidewalk and flush with the back of walk.
2. Street light conduit road crossings shall be in their own trench if applicable or in a joint trench with approval of the City Engineer.
3. The street light pull box shall have lockjaw security lid by Sipra Corp. or approved equal.

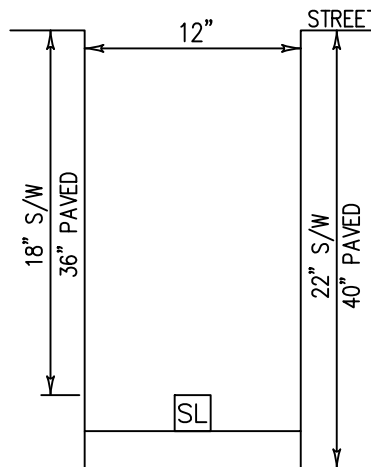

**TYPICAL STREET LIGHT
TRENCH SECTION**

LEGEND


G	GAS
P	ELECTRIC PRIMARY
S	ELECTRIC SECONDARY
T	TELEPHONE
C	CATV
SL	STREET LIGHT

NOTES:

1. All existing pavement shall be neatly sawcut to line prior to trench excavation.
2. All backfill materials shall be mechanically compacted unless approved otherwise by City Engineer.
3. Sand shall be clean natural sand per Caltrans Standard Specifications, Section 19-3.025B or native material at the direction of the City Engineer.
4. Minimum 6 ton roller shall be used to compact final lift of asphalt concrete. Hand operated asphalt compaction equipment may be used on first lift of asphalt only.
5. Street light conduit may be placed at the same level as the telephone or cable T.V. conduit.
4. Asphalt in trench to be installed to a depth 1" below the existing asphalt and paved in 1 1/2" minimum, 2 1/2" maximum lifts.

NOT TO SCALE

Approved by:



City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP
DEPARTMENT OF PUBLIC WORKS

**TYPICAL TRENCH
SECTIONS**




**STANDARD
DETAIL**

Date: **FEBRUARY 2022**

Drawing No:

E-1

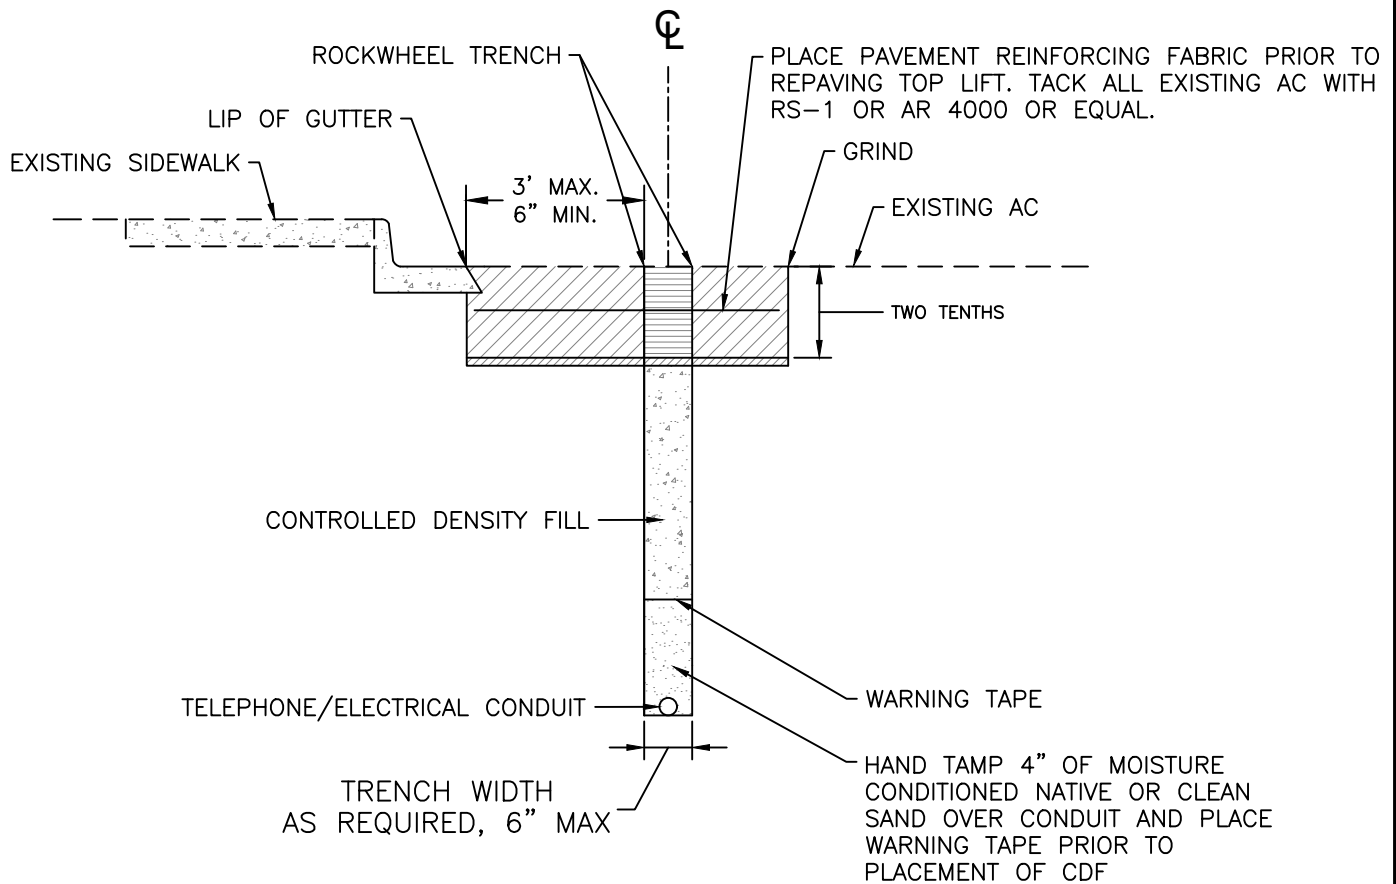

NOTES:

1. Allow controlled density fill (cdf) to set a minimum of 12 hours before placing asphalt concrete in trench.

NOT TO SCALE

Approved by:

[Signature]

City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP
DEPARTMENT OF PUBLIC WORKS

TRENCH BACKFILL
ROCKWHEEL TRENCH




**STANDARD
DETAIL**

Date: **FEBRUARY 2022**

Drawing No:

E-2

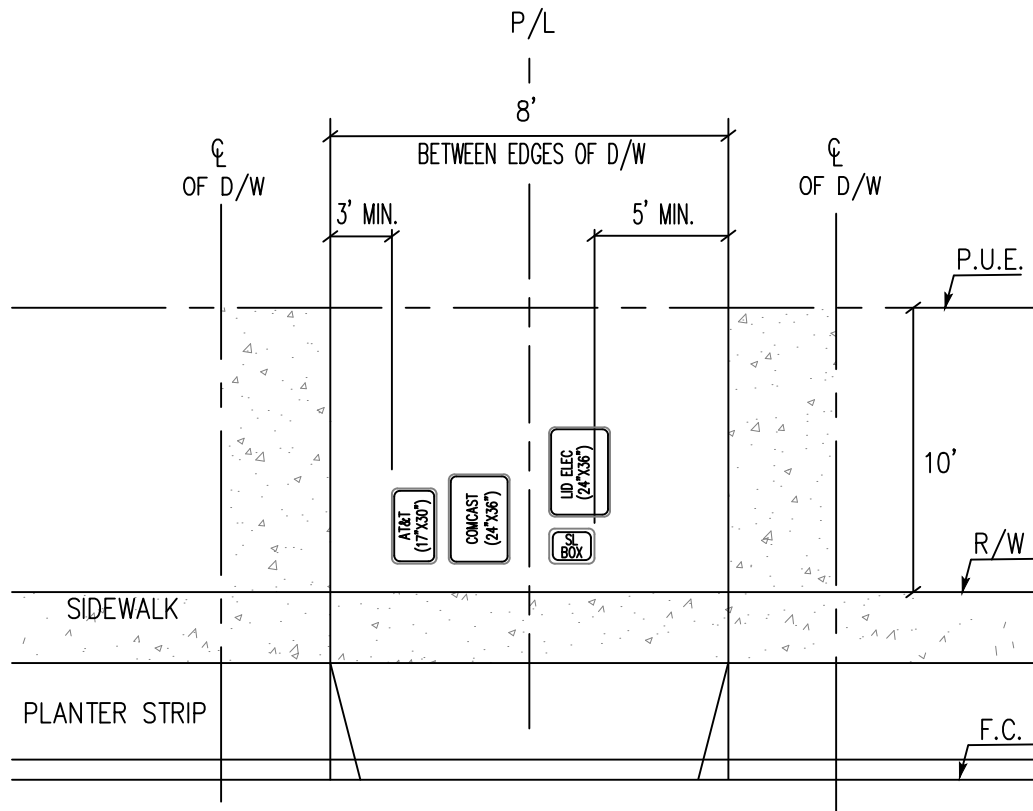

NOTES:

Configurations are not limited to the above detail. Contractor to verify configurations with utility companies and City staff prior to construction.

NOT TO SCALE

Approved by:

[Signature]

City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP
DEPARTMENT OF PUBLIC WORKS

**DRY UTILITY BOX/PEDESTAL
CONFIGURATION BETWEEN EDGES
OF RESIDENTIAL DRIVEWAYS**






**STANDARD
DETAIL**

Date: **FEBRUARY 2022**

Drawing No:

E-3

"LED" LIGHTS ONLY

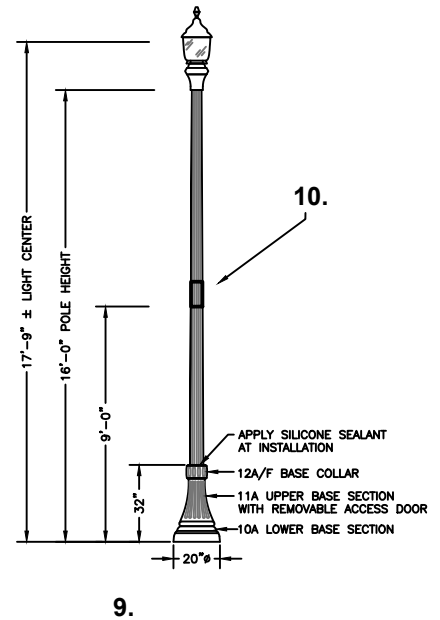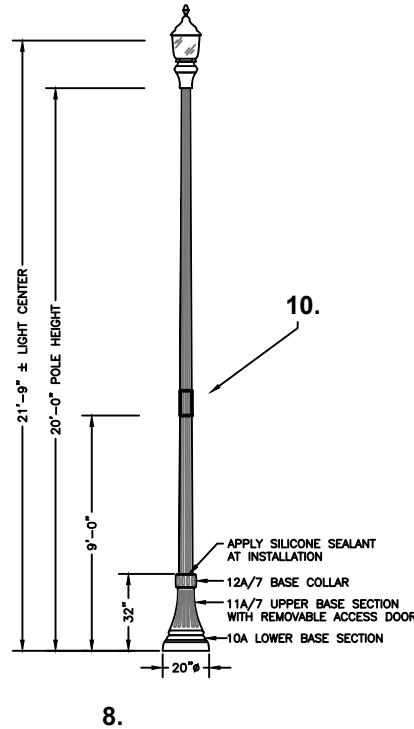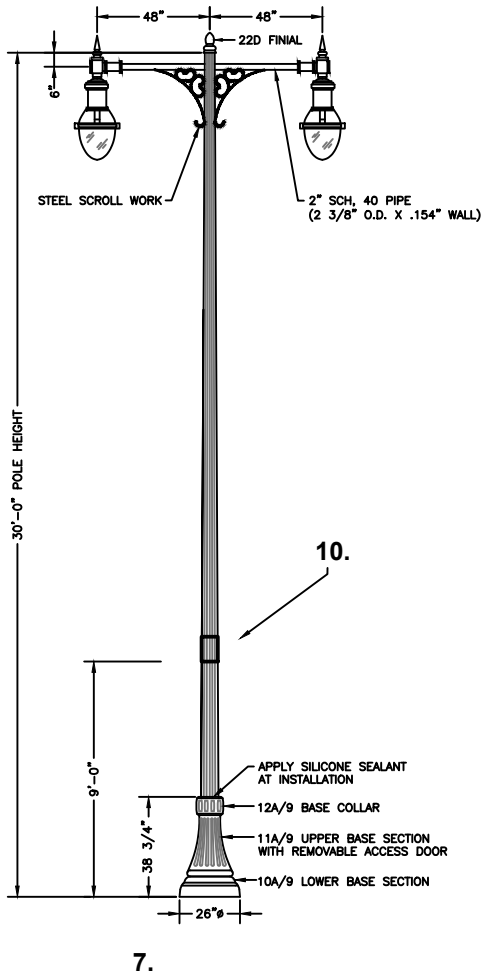

NOTES:

1. See improvement plans for pole height, luminaire wattage and distribution. Lighting spacing and brightness shall meet city, PG&E and State of California standards for illumination and safety.
2. Projects requiring installation of 4 or more electroliers shall be required to have plans prepared by and signed by a registered Electrical Engineer.
3. Electroliers along expressways and arterials shall be required to have plans prepared by and signed by a registered Electrical Engineer.
4. Electrolier finish shall be cast iron and steel, factory finish painted green-black, RAL-6012, per city standards.
5. Structural design of electroliers shall be performed by licensed structural or civil engineer.
6. Light poles shall be 11 ga., steel fluted tapered pole with 0.14 inches per foot taper.
7. Electroliers for arterial streets shall have a light post that is 9-inches in diameter, and a Lumec Luminaire #RN20-110W64LED4K-G3-ACDR-LE3R-UNV-DMG-SMA-RC-GN8TX.
8. Electroliers for collector streets shall have a light post that is 7-inches in diameter, and a Lumec Luminaire #S56-72W32LED4K-G3-ACDR-LE3W-UNV-DMG-SFX-FN1-HS-RC-TN2.875C-GN8TX.
9. Electroliers for residential streets shall have a light post that is 5 3/4-inches in diameter, and a Lumec Luminaire #S56-35W32LED4K-G3-ACDR-LE3W-UNV-DMG-SFX-FN1-HS-RC-TN2.875C-GN8TX.
10. Street light numbers to be on stickers, 2" letter size reflective black on white. Place numbers on street side of pole perpendicular to street.

NOT TO SCALE

Approved by:


[Signature]

City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP
DEPARTMENT OF PUBLIC WORKS

ELECTROLIER




**STANDARD
DETAIL**

Date: **FEBRUARY 2022**

Drawing No:

E-4

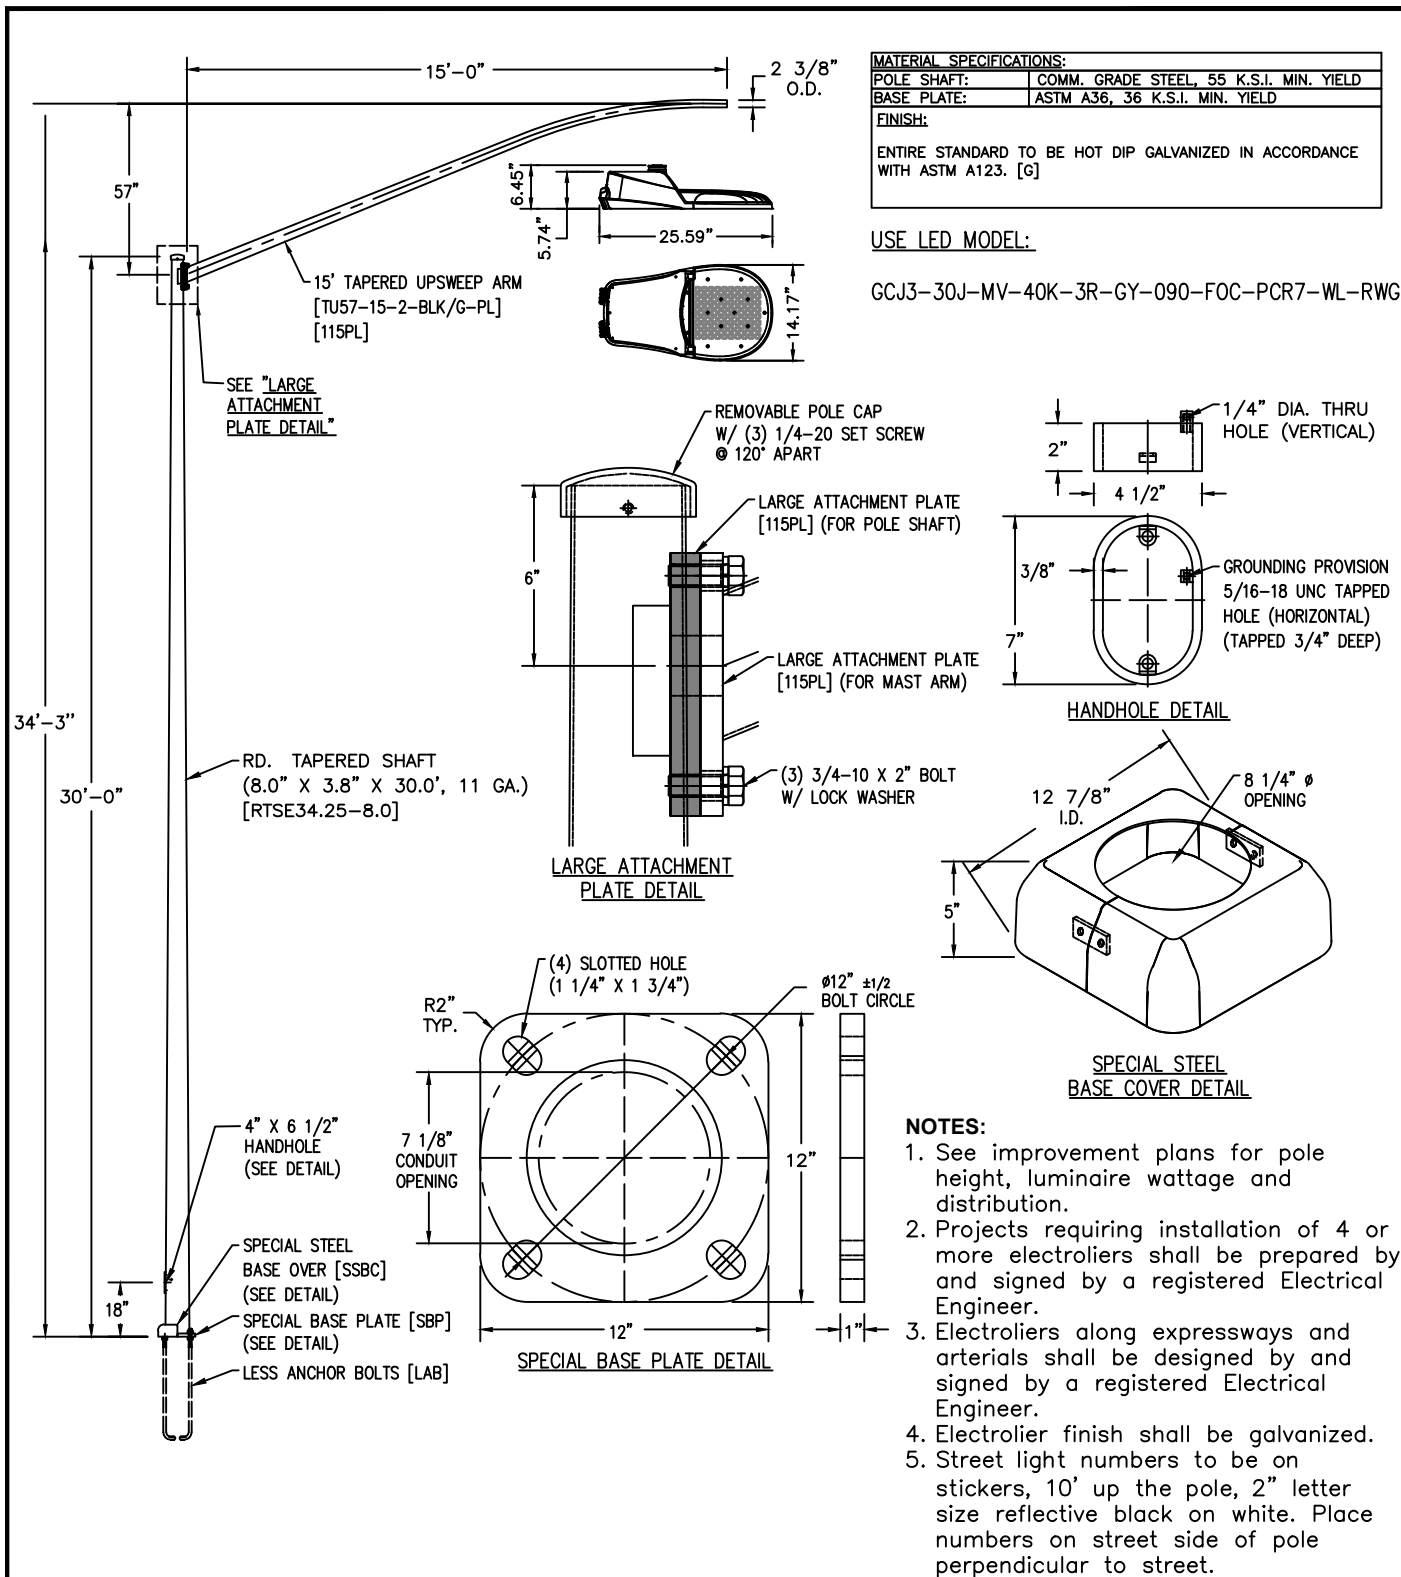

NOT TO SCALE

Approved by:

[Signature]
City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP

DEPARTMENT OF PUBLIC WORKS

COBRA HEAD LIGHT DETAILS FOR COMMERCIAL AND INDUSTRIAL




STANDARD DETAIL




Date: **FEBRUARY 2022**

Drawing No:

E-5

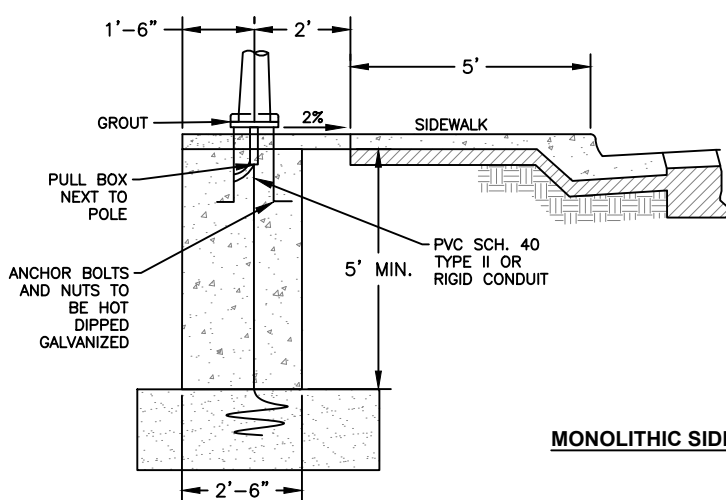

MONOLITHIC SIDEWALK

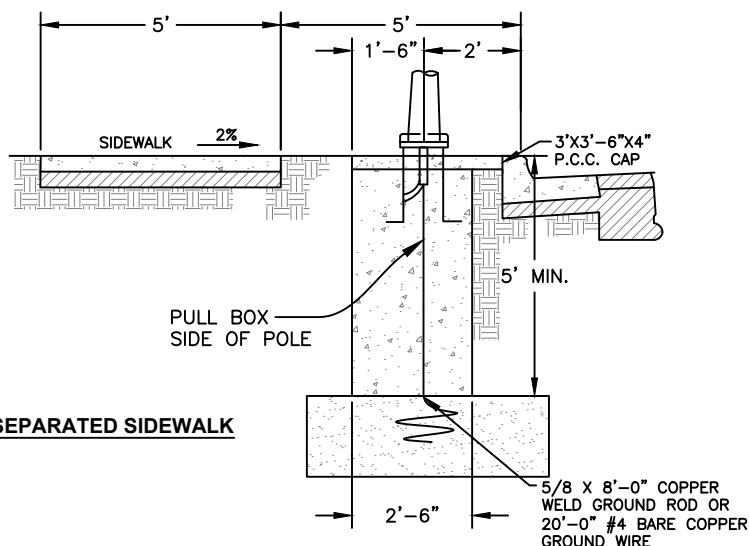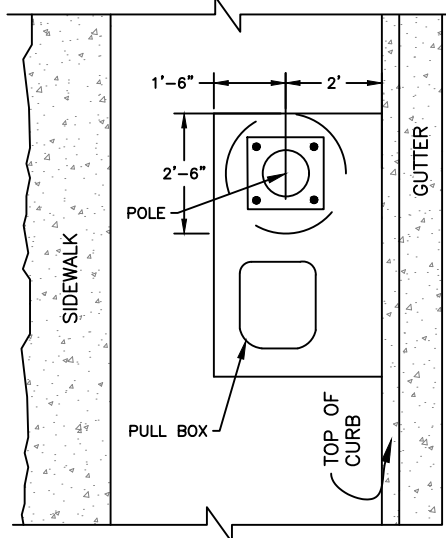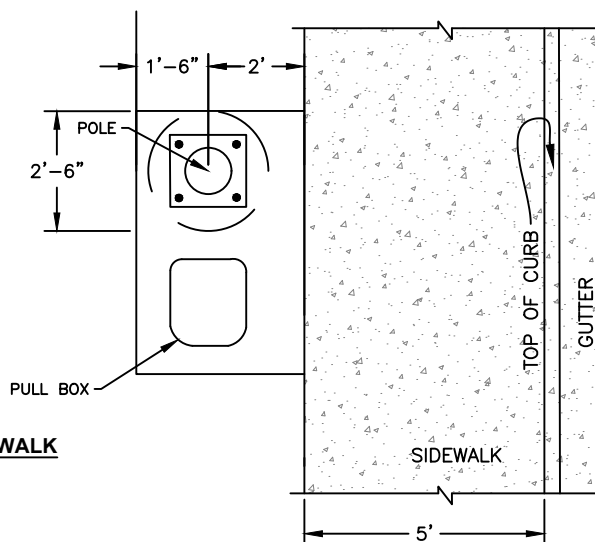

SEPARATED SIDEWALK

NOTES:

1. Secure electrolier to grounded stud.
2. 20' #4 bare copper, ground wire or 5/8" x 8' copper weld ground rod shall be covered with 2" of soil prior to pouring base.
3. Base shall be 3,000 PSI concrete field cast.
4. Street light pull box to have lockjaw security lid by Sipra Corp. or approved equal.
5. Minimum conduit size shall be 1 1/2", minimum radius at bends shall be 18".
6. Pull boxes shall be installed down stream and incorporated into pad.
7. All connection shall be waterproof.
8. Minimum cover over conduit shall be 18" under sidewalks.
9. All wiring shall extend 30" min. into pull box, with extra slack to be coiled in box.
10. All conduits terminating in pull boxes shall have duct sealant.
11. Ground Rods shall be installed at the beginning of all runs.
12. See Standard Detail E-12 for service box detail.

NOT TO SCALE

Approved by:

[Signature]

City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP
DEPARTMENT OF PUBLIC WORKS

**ELECTROLIER
BASE**




**STANDARD
DETAIL**

Date: **FEBRUARY 2022**

Drawing No:

E-6

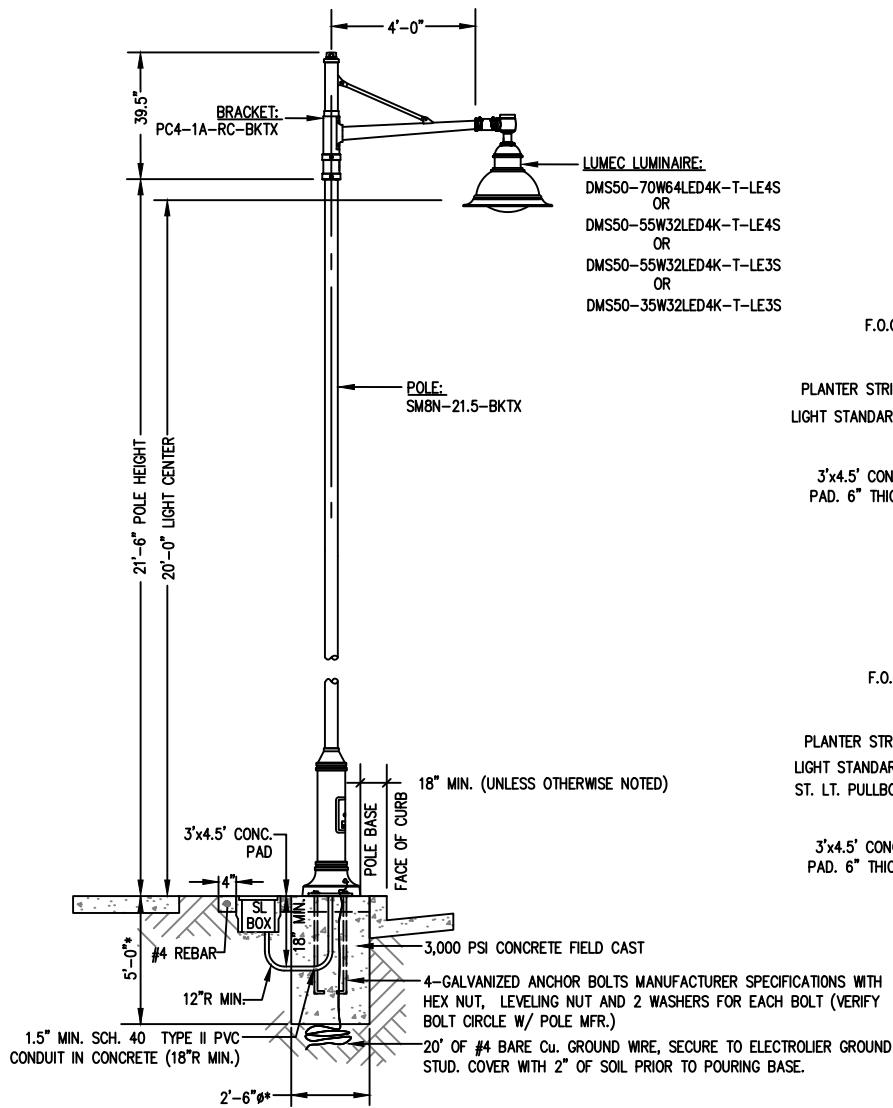


*FOUNDATION PER CITY STANDARD


**STREET LIGHT AND BOX
PROFILE VIEW**

NOTE:

1. If concrete pad is poured between the back of curb and front of sidewalk, then felt or other expansion material will be required.
2. See Standard Detail E-12 for service box detail.

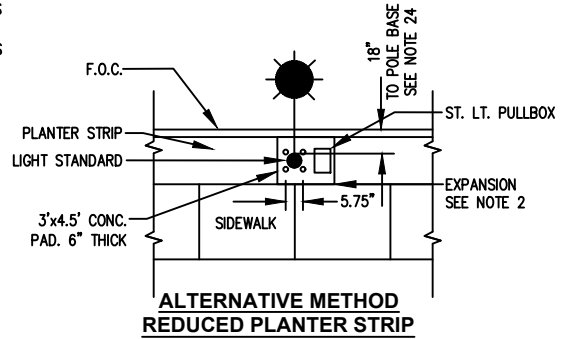

**ALTERNATIVE METHOD
REDUCED PLANTER STRIP**

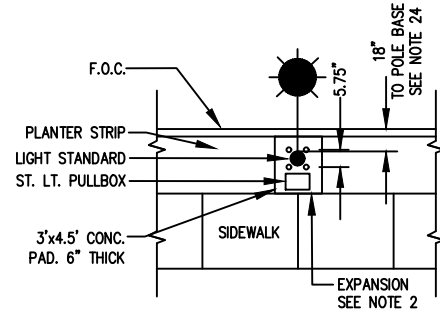

**STREET LIGHT AND BOX
CONFIGURATION**

NOT TO SCALE

Approved by:

[Signature]

City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP
DEPARTMENT OF PUBLIC WORKS

**RIVER ISLANDS
ELECTROLIER DETAILS**




**STANDARD
DETAIL**

Date: **FEBRUARY 2022**

Drawing No:

E-7

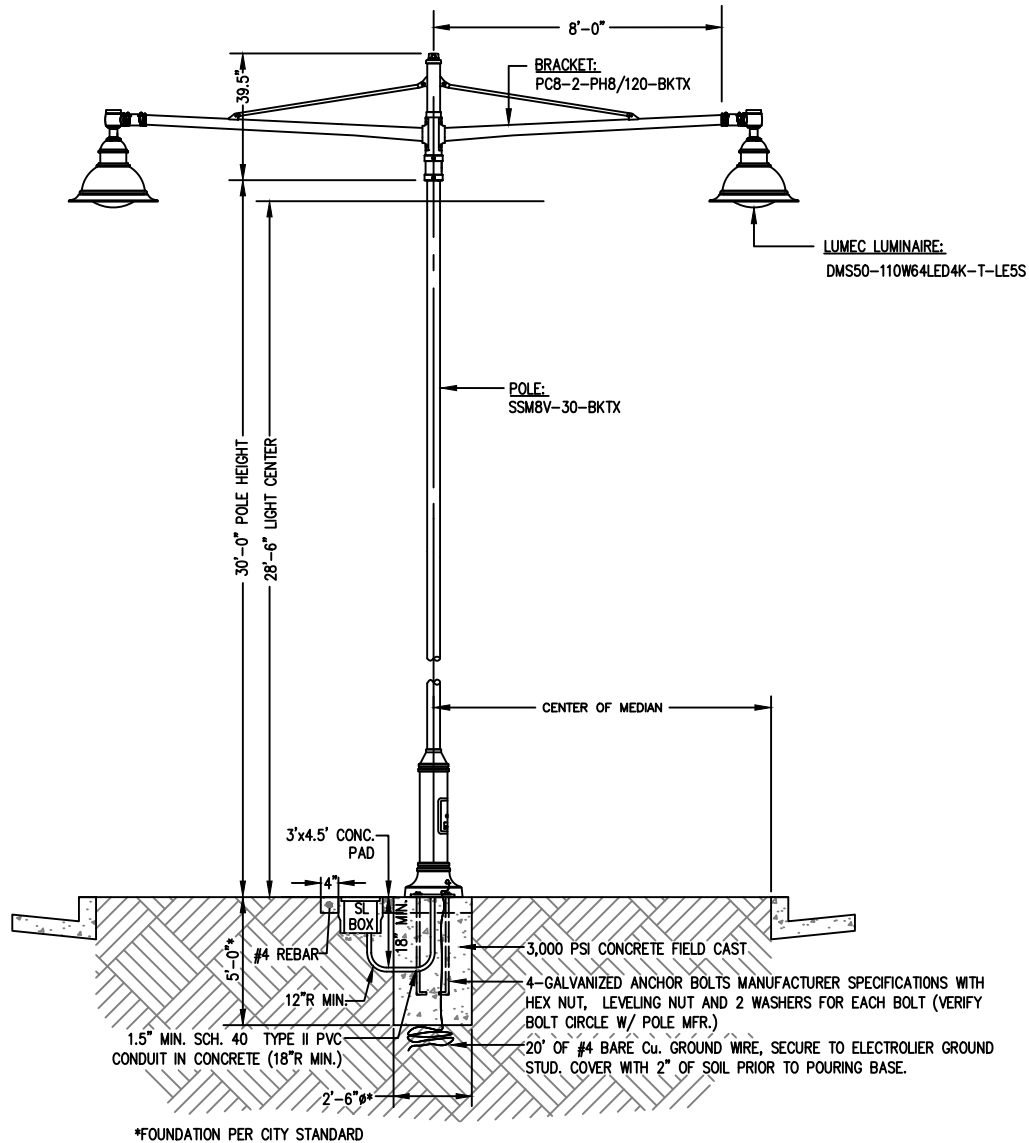

**STREET LIGHT AND BOX
PROFILE VIEW**

NOTE:

1. If concrete pad is poured between the back of curb and front of sidewalk, then felt or other expansion material will be required.
2. See Standard Detail E-12 for service box detail.

NOT TO SCALE

Approved by:

[Signature]

City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP
DEPARTMENT OF PUBLIC WORKS

**RIVER ISLANDS
DOUBLE ARM
ELECTROLIER DETAILS**




**STANDARD
DETAIL**

Date: **FEBRUARY 2022**


Drawing No:

E-7A

STREET CLASSIFICATION	STREET R/W WIDTH	NORMAL MOUNTING HEIGHT	LIGHT EMITTING DIODE LAMP WATTAGE	FRONT OF LOT	BACK OF LOT
				SPACING (BOTH SIDES)	
EXPRESSWAY	128'	*	250/400	*	*
MAJOR ARTERIAL	104'	*	250	*	*
MINOR ARTERIAL	84'	*	150	*	*
SPACING (ALTERNATE SIDES)					
COLLECTOR/ INDUSTRIAL/ COMMERCIAL					
	60'	30'	150		190'
LOCAL/COLLECTOR	64'	22'	150		150'
RESIDENTIAL	60'	18'	100		150'

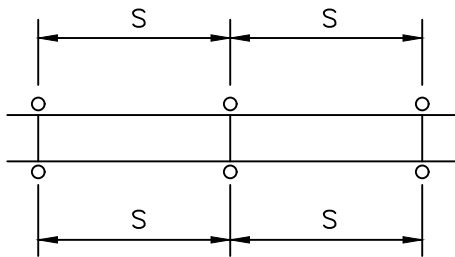

SPACING BOTH SIDES

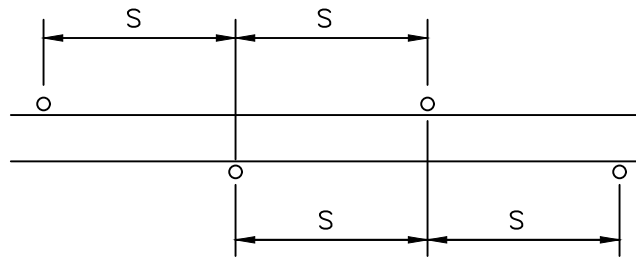

SPACING (ALTERNATE SIDES)


NOTES:

1. Lamp wattage shall be for light emitting diode lamp only.
2. Spacing may be adjusted to allow for driveways, street intersections, etc.
3. Light distribution pattern shall be Type III per the latest Caltrans Standard Plans unless otherwise specified on improvement plans.

*Electroliers along expressways and arterials shall be required to have plans prepared and signed by a registered Electrical Engineer.

NOT TO SCALE

Approved by:



City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP
DEPARTMENT OF PUBLIC WORKS

**STREET LIGHT POLE
SPACING GUIDE**




**STANDARD
DETAIL**

Date: **FEBRUARY 2022**

Drawing No:

E-8

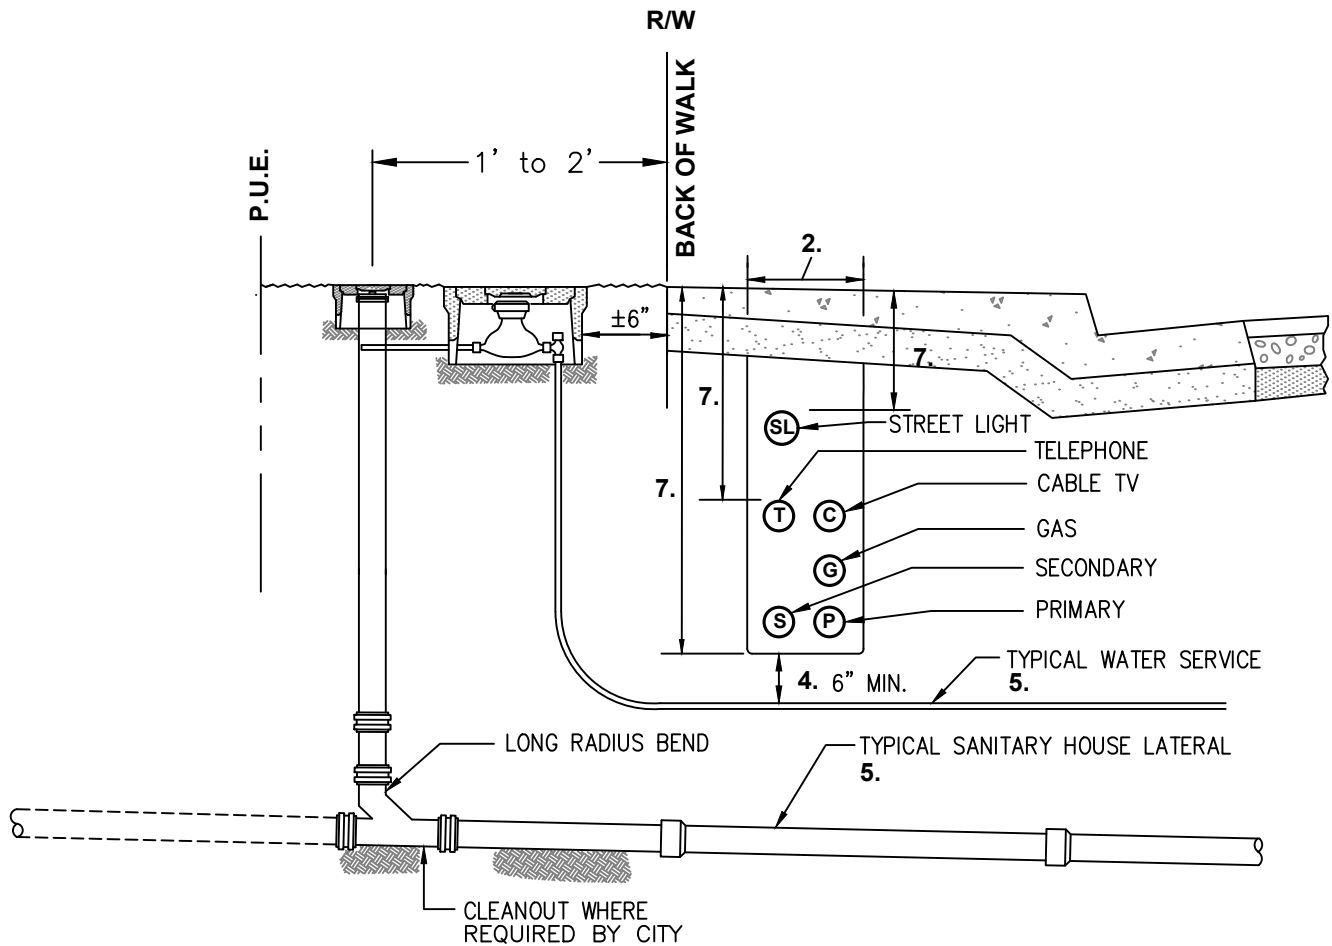

NOTES:

TYPICAL SECTION

1. © Denotes cable and / or conduit.
2. Compaction shall be per Standard Detail No. R-56
3. Utilities to be placed as per public utility company regulations.
4. All Services crossing underneath electrical lines shall have a minimum 6" clearance.
Electrical lines shall have a minimum of 12" clearance if placed below service laterals.
5. Water service and Sanitary service shall have a lateral clearance of 48" minimum.
6. The location of trench shall conform to City requirements.
7. Refer to Standard Detail No. E-1 for depth requirements.
8. Tree Planting must be 5' from utilities.

NOT TO SCALE

Approved by:

[Signature]
City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP DEPARTMENT OF PUBLIC WORKS UNDERGROUND UTILITIES LOCATIONS BEHIND FACE OF CURB




STANDARD DETAIL

Date: **FEBRUARY 2022**

Drawing No:

E-9

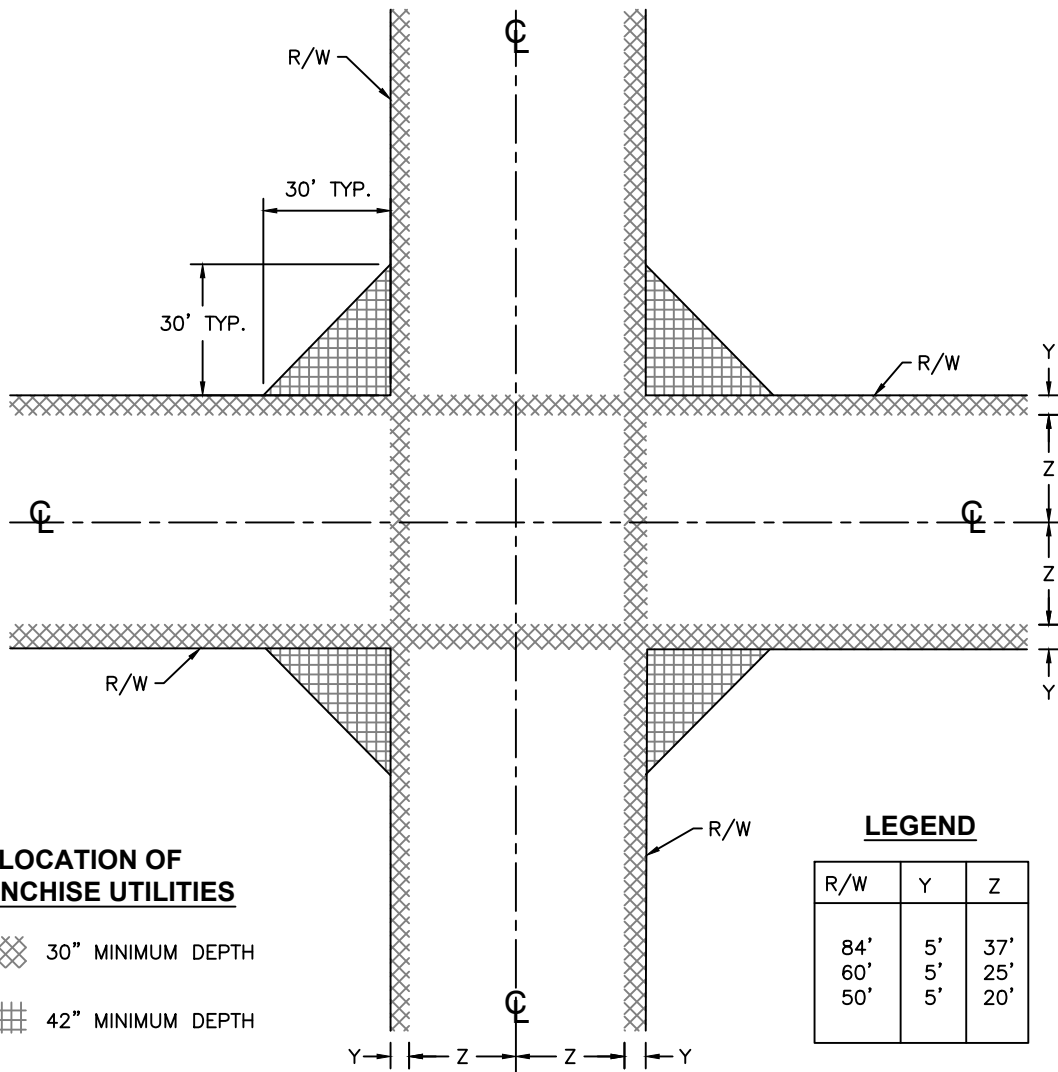

NOTES:

- Any deviations from the standard locations are subject to the approval of the City Engineer.
- Franchise utilities shall include telephone, gas, electrical, television cable, etc.

NOT TO SCALE

Approved by:

[Signature]

City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP
DEPARTMENT OF PUBLIC WORKS
UNDERGROUND UTILITIES
LOCATIONS
AT EXISTING INTERSECTIONS




STANDARD
DETAIL

Date: **FEBRUARY 2022**


Drawing No:

E-10

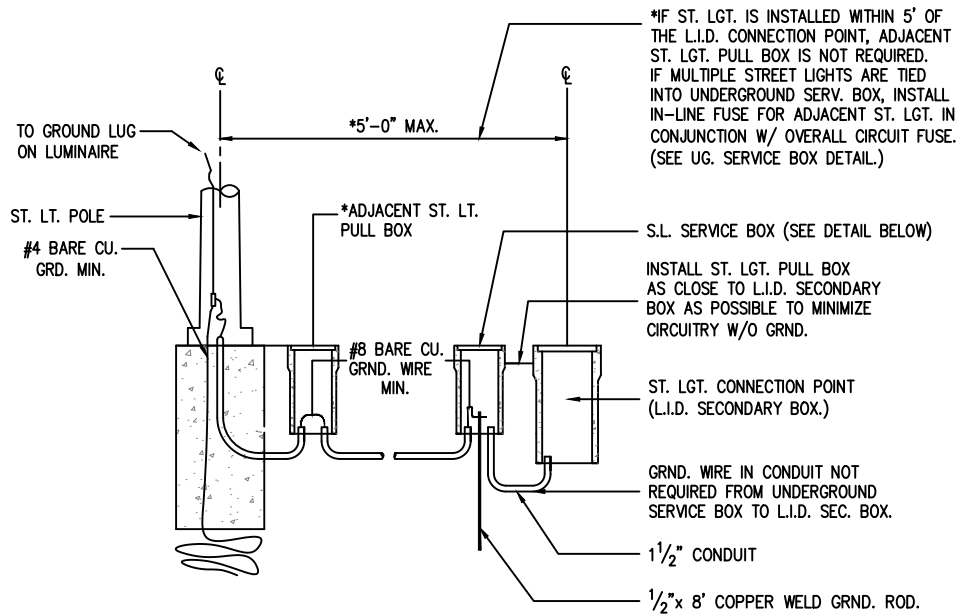

GROUNDING DETAIL

NOT TO SCALE

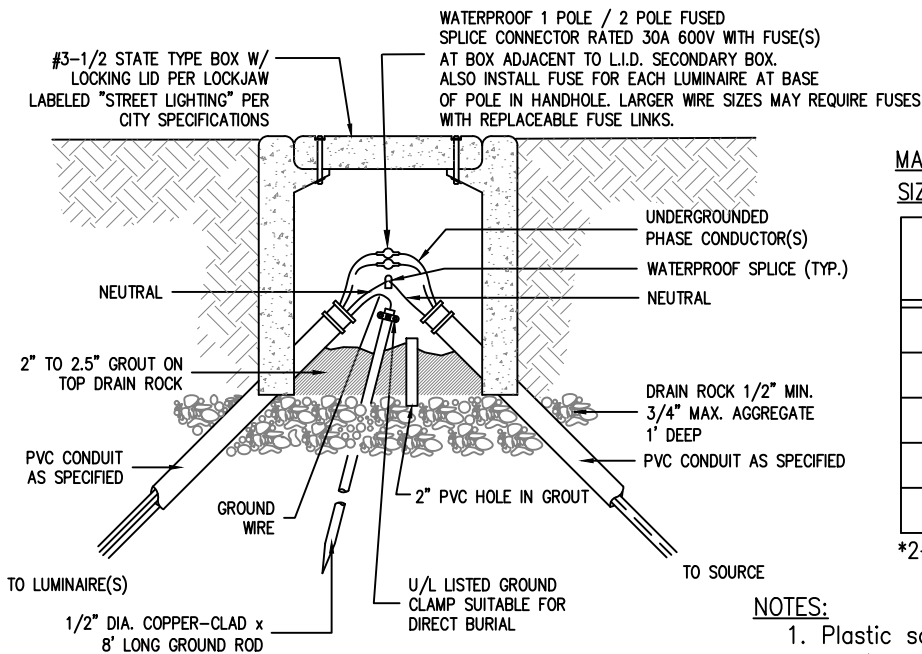

STREETLIGHT SERVICE BOX DETAIL

NOT TO SCALE

MANUFACTURER RECOMMENDED FUSE SIZES (SLOW BLOW CHARACTERISTIC)

LED LUMINAIRE WATTAGE	SLOW BLOW FUSE RATING
35	1 AMP
55	1 AMP
70	2 AMP
2-110*	4 AMP
135	3 AMP

*2-110W ON COMMON (SAME) PHASE

NOTES:

1. Plastic sand and grout theft deterrent maybe required at the direction of the City Engineer.
2. All conduits must be plugged or capped (PVC cap).
3. 2" of conduit above grout.

NOT TO SCALE

Approved by:

[Signature]

City Of Lathrop
Public Works Director

No	Revised	Date

CITY OF LATHROP
DEPARTMENT OF PUBLIC WORKS

SERVICE BOX DETAILS



**STANDARD
DETAIL**

Date: **FEBRUARY 2022**

Drawing No:

E-11